


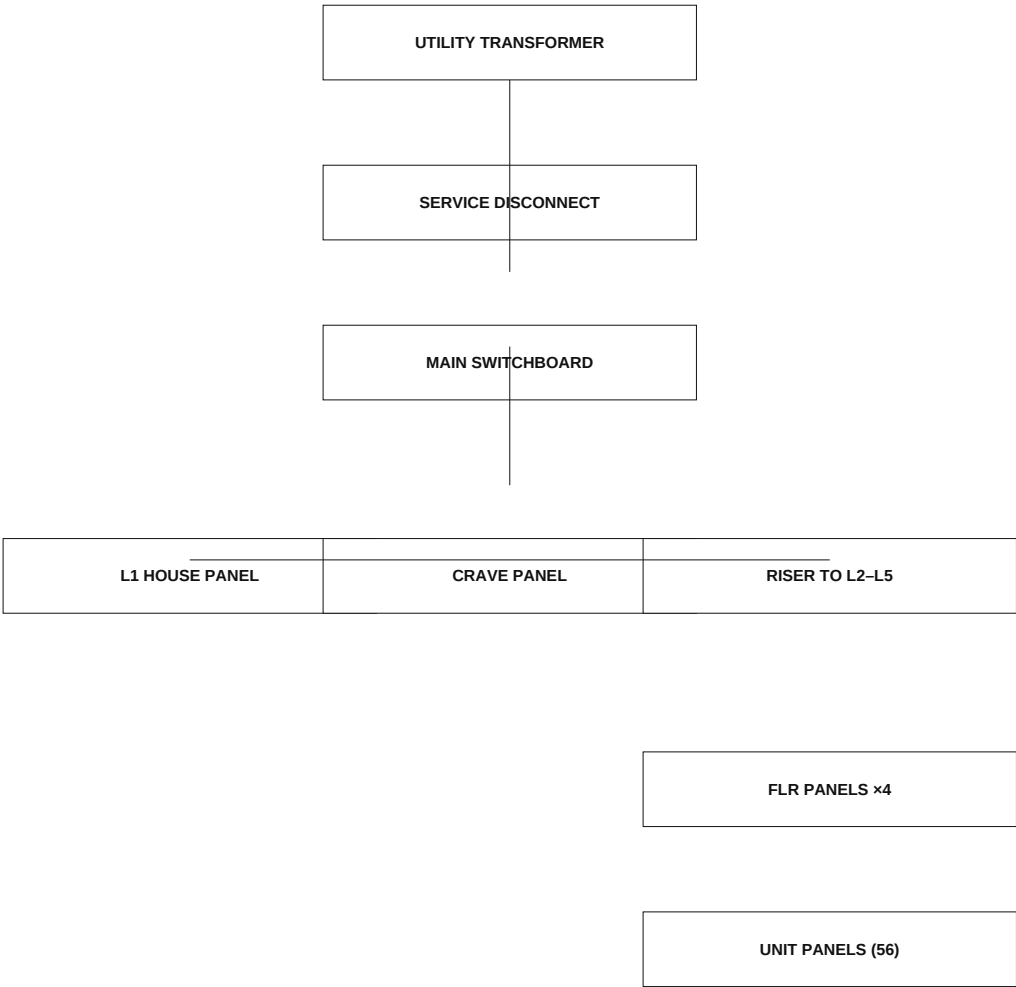

ELECTRICAL CRITERIA

Service allowance: 1200–1600A 208Y/120
confirm with utility + load calc
Emergency/exit lighting + generator
or inverter per PE
Unit panels: 100–125A typ
Kitchen: heavy loads / hood / equip
Fire alarm separate riser
Telecom / data backbone NIC AE
Lightning / surge PE
Panel schedules: sealed MEP
Photovoltaic NIC

MIRAGE @ MANHATTAN

1705 Manhattan Blvd · Harvey, LA 70058 · Jefferson Parish

ELECTRICAL ONE-LINE SCHEMATIC + SERVICE ALLOWANC

SHEET E1.0

SCALE: N/A

CD-DRAFT-2 · FULL BUILD-OUT · JUL 15, 2026

OWNER-GC CD DRAFT · NOT SEALED

AOR / PE SEAL

(blank — Louisiana license)