


TYP FLOOR PLAN · 14 KEYS · FF 12'-0"
12×610 + 2×850 · HALLS & LINK 6'-0" · PACK 30+6+30+6+28 · LAYOUT LOCK Jul 12

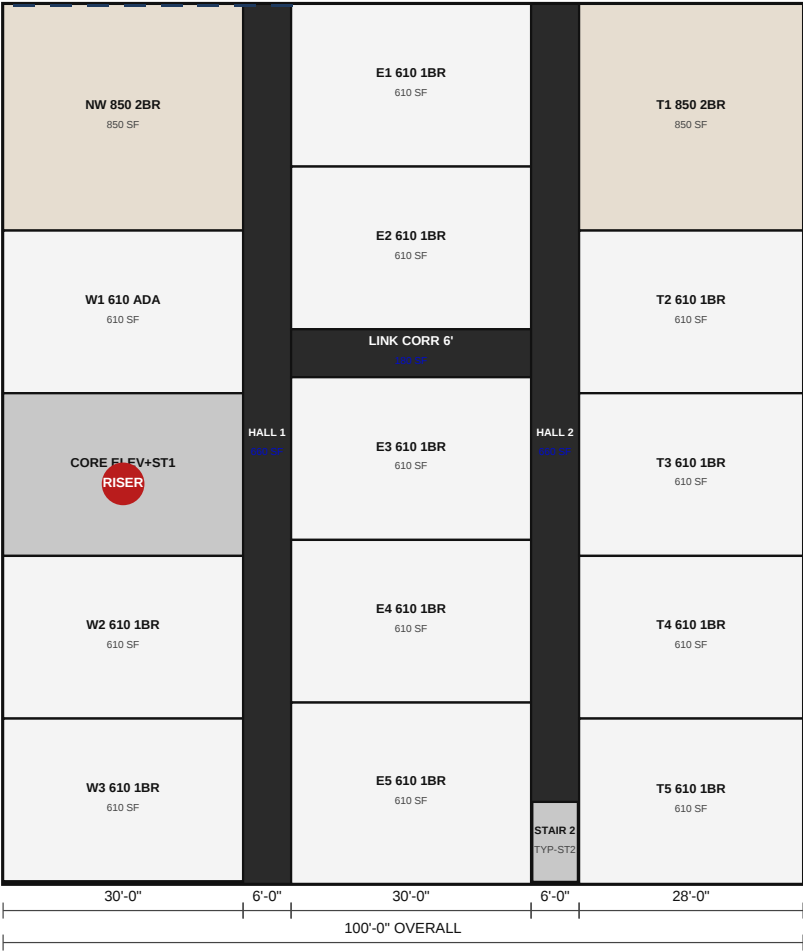

NFPA 13 DESIGN CRITERIA

System: wet-pipe NFPA 13 (not 13R)
Occupancy: LH / OH1 verify by room
Density / area: PE hydraulic calc
Riser preferred at CORE (shown)
Standpipe as IBC/IFC requires
Heads: quick-response residential ok R-2
Kitchen: hood suppression separate
Backflow / FDC: civil + FD
Monitoring: IFC / Parish
Sealed FP drawings by FP PE

CD DRAFT for bidding & AOR/PE completion. Geometry & TAKEOFF-4 quantities locked. Member sizes, sealed calcs, shop drawings by licensed professionals.

MIRAGE @ MANHATTAN
1705 Manhattan Blvd · Harvey LA 70058 · Jefferson Parish

FIRE PROTECTION — NFPA 13 CRITERIA + RISER

SHEET FP1.0

SCALE: N/A

CD-DRAFT-2 · FULL BUILD-OUT · Jul 15, 2026

OWNER-GC CD DRAFT · NOT SEALED

AOR / PE SEAL
(blank — Louisiana license)